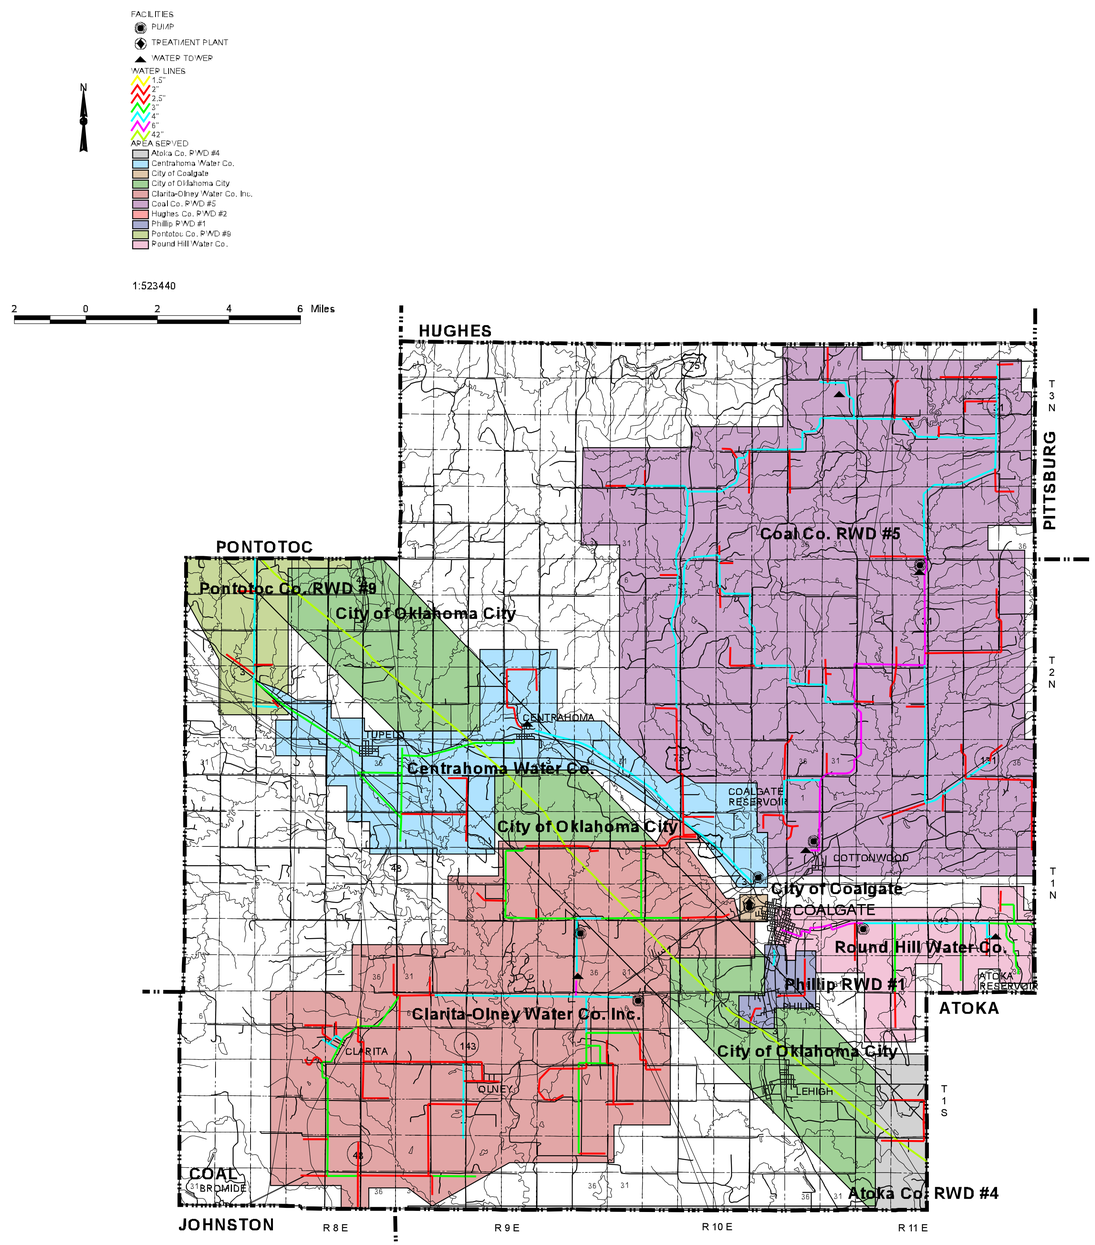
FACILITIES
PUMP
TREATMENT PLANT
WATER TOWER
WATER LINES
1.5"
2"
2.5"
3"
4"
6"
42"
AREA SERVED
Atoka Co. RWD #4
Centrahoma Water Co.
City of Coalgate
City of Oklahoma City
Clarita-Olney Water Co. Inc.
Coal Co. RWD #5
Hughes Co. RWD #2
Phillip RWD #1
Pontotoc Co. RWD #9
Round Hill Water Co.
N
1:523440
2 0 2 4 6 Miles
HUGHES
PITTSBURG
PONTOTOC
Pontotoc Co. RWD #9
City of Oklahoma City
Coal Co. RWD #5
CENTRAHOMA
TUPELO
Centrahoma Water Co.
City of Oklahoma City
COALGATE RESERVOIR
COTTONWOOD
City of Coalgate
COALGATE
Round Hill Water Co.
Phillip RWD #1
PHILLIP
ATOKA RESERVOIR
ATOKA
Clarita-Olney Water Co. Inc.
CLARITA
OLNEY
City of Oklahoma City
LEHIGH
COAL
BROMIDE
Atoka Co. RWD #4
JOHNSTON
T 3 N
T 2 N
T 1 N
T 1 S
R 8 E
R 9 E
R 10 E
R 11 E